




4'-0" CONCRETE WATERWAY

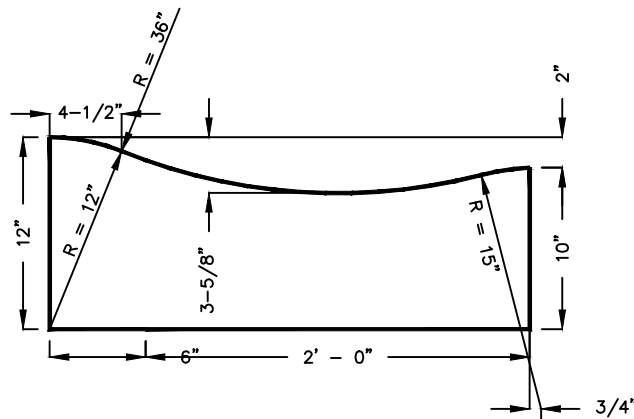


30" CONCRETE ROLLED CURB & GUTTER

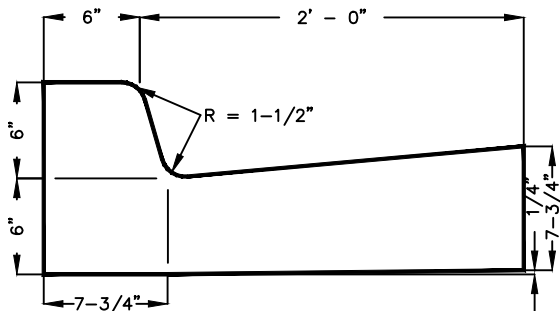

30" CONCRETE STANDARD CURB & GUTTER

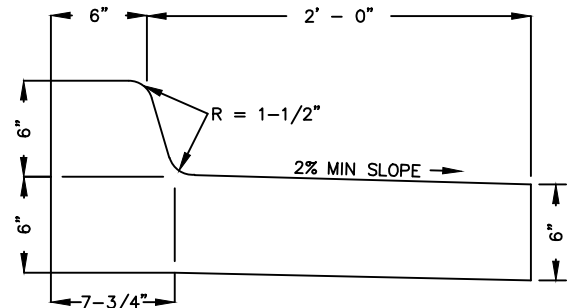

30" CONCRETE STANDARD OUTFALL CURB & GUTTER

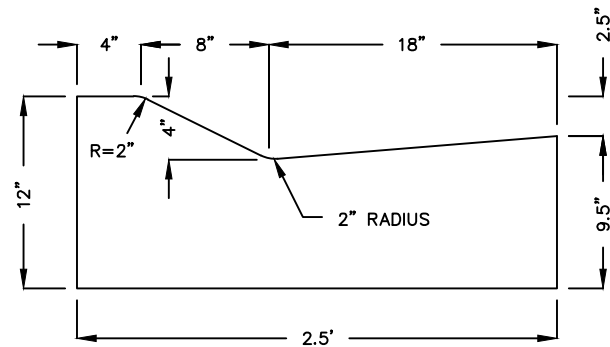

30" CONCRETE MODIFIED CURB & GUTTER

GENERAL NOTES

1. CONCRETE SHALL COMPLY WITH SANDY CITY STANDARD SPECIFICATION SECTION 03000.
2. PLACE EXPANSION-CONTRACTION JOINTS, (JOINT FILLER MATERIAL FULL DEPTH OF CONCRETE PLUS 1 INCH, FLUSH WITH TOP OF CONCRETE) EVERY 50 FEET FOR HAND SET FORMING.
3. PLACE CONTROL JOINTS AT 10 FOOT INTERVALS.
4. ALL REINFORCING STEEL TO BE A MINIMUM OF THREE INCHES CLEAR CONCRETE COVERAGE UNLESS OTHERWISE SHOWN.
5. MODIFIED, ROLLED AND OUTFALL GUTTER SHALL NOT BE USED FOR NEW CONSTRUCTION UNLESS AUTHORIZED BY THE ENGINEER.
6. EDGE CONCRETE WITH A 1/2" EDGING TOOL.
7. USE 6" MIN. UNTREATED BASE COARSE MATERIAL. COMPACT TO 96% OF MAXIMUM DRY DENSITY.
8. STAGGER LAP SPLICES WITH A MINIMUM OF 15 INCHES.
9. FORM OIL CONTAMINATED REINFORCING STEEL WILL BE REJECTED.
10. COMPLY WITH SANDY CITY STANDARD SPECIFICATION, DIVISION #3, SECTION 03050.

1	M. GLADBACH	OUTFALL C & G NOTE 11	3/23/04
2	M. GLADBACH	MODIFIED C & G	5/8/06
3	M. GLADBACH	MODIFIED NOTE 1	3/3/15



STANDARD DETAIL
CG-01
CURB AND GUTTER

NO.	AUTHORIZED BY	REVISIONS	DATE
-----	---------------	-----------	------